


FUNNELS

DRIP AND CONDENSATE FUNNELS

FUNCTION: Ideal for hospitals and industrial laboratories where indirect waste lines above the floor require receptors to receive drip, condensate or waste water. Use of "P" trap recommended for preventing sewer gases from entering room.

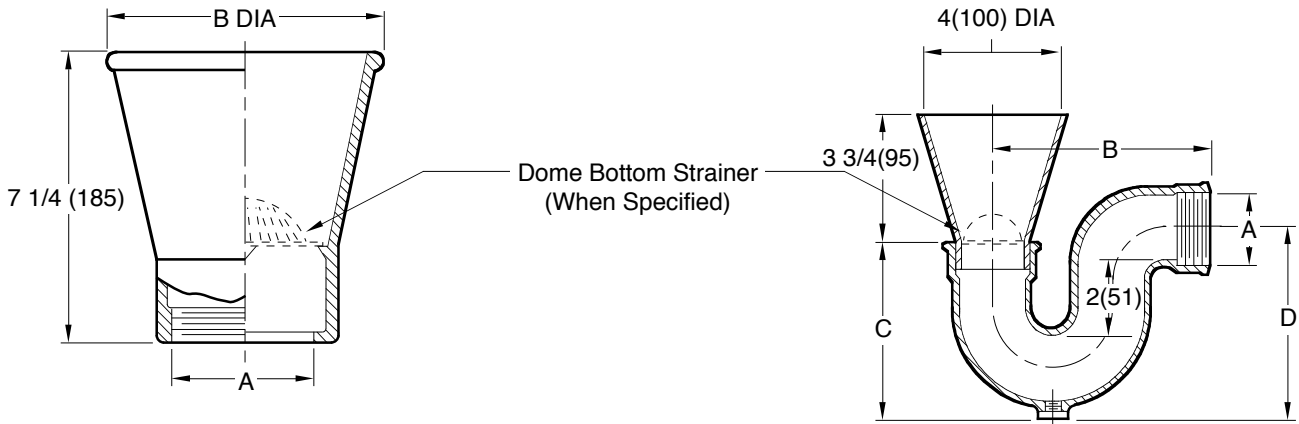

CAULK OUTLET

A = PIPE SIZE	02(50)	03(75)	04(100)	06(150)
B	6(150)	7(180)	8(205)	10(255)

THREADED OUTLET ONLY

A = PIPE SIZE	B	C	D
0150(40), 02(50)	6(150)	5(125)	5 1/2(140)
03(75)	6(150)	6(150)	6(150)

- Fig. 3811C CAST IRON WITH ACID RESISTANT..... Fig. 3821T
COATED INTERIOR AND EXTERIOR
- Fig. 3812C DUCO COATED CAST IRON Fig. 3822T
- Fig. 3813C CAST BRONZE Fig. 3823T
- Fig. 3814C POLISHED CHROME PLATED CAST BRONZE..... Fig. 3824T

REGULARLY FURNISHED:
As described by Figure Number.

- VARIATIONS:**
- Aluminum Dome Bottom Strainer -DBS
 - Dome Bottom Strainer (Same finish and materials as described by Figure No.)
 - Less Cleanout (Fig. 3820 Series only)
 - With Front Cleanout (Fig. 3820 Series only)
 - NO-HUB Adaptor 02(50), 03(75), 04(100) or 06"(150) sizes only (Specify Fig. 2646Y)
 - T Threaded Outlet

OPTIONAL MATERIALS:
 All Galvanized -G

NOTE: Dimensions shown in parentheses are in millimeters.

DRAWING NUMBER **S3811**
 SIZE **A**
 SCALE: **NONE**
 DATE: **9-19-85**
 APPROVED BY: **SJM**
 CHECKED BY: **JD**
 DRAWN BY: **PJ**
 FIGURE NUMBER **3811, 3812, 3813, 3814, 3821, 3822, 3823, 3824**

WE CAN ASSUME NO RESPONSIBILITY FOR USE OF SUPERSEDED OR VOID DATA

E	10-18-17	Revised Description 3811/3821	TBW	CR	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER 3811, 3812, 3813, 3814 3821, 3822, 3823, 3824
D	6-11-99	Revised description	CMD	BS			
C	5-7-99	Changed 03(80) to 03(75)	CMD	BS			
B	8-26-96	Added Millimeters	EMB	BS			
REV.	DATE	DESCRIPTION	BY	CKD. BY			